

STATEMENT OF PERFORMANCE


Test: Structural

Standard: BS EN 1195:1998 and BS EN 12872:2010

Independent Test Report: UK22439 (QT-63802/1/AS)/Ref. 2

Product: OMNIE TorFloor 2®

Construction: 22mm P5 TorFloor 2® Deck Panel with 6mm aluminium lined TorFloor 2® Cover Panel screwed down.

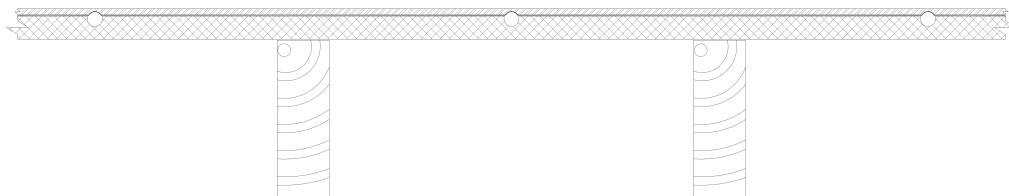

This is to confirm that the OMNIE TorFloor 2® structure with specific OMNIE TorFloor 2® pattern as described above, assembled as per OMNIE installation guide, laid over joists at 400mm centres, has been tested in accordance with the British Standards BS EN 1195:1998 and BS EN 12872:2010, assessed against requirements of Class I of BS EN 12871:2013 (E), and has passed.

The testing was done by an UKAS accredited, external consultancy lab.

Point Load results yielded a preliminary $F_{max,est}$ of 7.02 kN.