

DuPont de Nemours (Luxembourg) S.à r.l

Rue General Patton

L-2984

Luxembourg

Tel: 0117 452 9052/9053

e-mail: tyvek.construction@dupont.com

website: www.dupont.co.uk/building.html



Agrément Certificate

90/2548

Product Sheet 1 Issue 9

TYVEK CONSTRUCTION MEMBRANES

TYVEK HOUSEWRAP

This Agrément Certificate Product Sheet ⁽¹⁾ relates to Tyvek⁽²⁾ Housewrap, a high-density polyethylene (HDPE) breather membrane, for use in external walls in timber-frame (either factory or site applied), steel-frame and masonry constructions behind lightweight cladding panels and masonry facades.

(1) Hereinafter referred to as 'Certificate'.

(2) Tyvek is a registered trademark of E.I. du Pont de Nemours & Co. or its affiliates.

The assessment includes

Product factors:

- compliance with Building Regulations
- compliance with additional regulatory or non-regulatory information where applicable
- evaluation against technical specifications
- assessment criteria and technical investigations
- uses and design considerations

Process factors:

- compliance with Scheme requirements
- installation, delivery, handling and storage
- production and quality controls
- maintenance and repair

Ongoing contractual Scheme elements†:

- regular assessment of production
- formal 3-yearly review



KEY FACTORS ASSESSED

- Section 1. Mechanical resistance and stability
- Section 2. Safety in case of fire
- Section 3. Hygiene, health and the environment
- Section 4. Safety and accessibility in use
- Section 5. Protection against noise
- Section 6. Energy economy and heat retention
- Section 7. Sustainable use of natural resources
- Section 8. Durability

The BBA has awarded this Certificate to the company named above for the product described herein. This product has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Date of Ninth issue: 6 June 2024
Originally certified on 13 November 1990

Hardy Giesler
Chief Executive Officer

This BBA Agrément Certificate is issued under the BBA's Inspection Body accreditation to ISO/IEC 17020. Sections marked with † are not issued under accreditation.

The BBA is a UKAS accredited Inspection Body (No. 4345), Certification Body (No. 0113) and Testing Laboratory (No. 0357).

Readers MUST check that this is the latest issue of this Agrément Certificate by either referring to the BBA website or contacting the BBA directly.

The Certificate should be read in full as it may be misleading to read clauses in isolation.

Any photographs are for illustrative purposes only, do not constitute advice and should not be relied upon.

British Board of Agrément

1st Floor, Building 3, Hatters Lane
Croxley Park, Watford
Herts WD18 8YG

©2024

tel: 01923 665300
clientservices@bbacerts.co.uk
www.bbacerts.co.uk

SUMMARY OF ASSESSMENT AND COMPLIANCE

This section provides a summary of the assessment conclusions; readers should refer to the later sections of this Certificate for information about the assessments carried out.

Compliance with Regulations

Having assessed the key factors, the opinion of the BBA is that Tyvek Housewrap, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements of the following Building Regulations:



The Building Regulations 2010 (England and Wales) (as amended)

Requirement:	B3(4)	Internal fire spread
Comment:		The product can contribute to satisfying this Requirement. See section 2 of this Certificate.
Requirement:	B4(1)	External fire spread
Comment:		The product is restricted by this Requirement. See section 2 of this Certificate.
Requirement:	C2(b)	Resistance to moisture
Comment:		The product will contribute to satisfying this Requirement. See section 3 of this Certificate.
Requirement:	C2(c)	Resistance to moisture
Comment:		The product can contribute to satisfying this Requirement. See section 3 of this Certificate.
Regulation:	7(1)	Materials and workmanship
Comment:		The product is acceptable. See sections 8 and 9 of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)	Fitness and durability of materials and workmanship
Comment:		The product can contribute to satisfying this Regulation. See sections 8 and 9 of this Certificate.
Regulation:	9	Building standards – construction
Standard:	2.4	Cavities
Comment:		The product can contribute to satisfying this Standard, with reference to clause 2.4.2 ⁽¹⁾⁽²⁾ . See section 2 of this Certificate.
Standard:	3.10	Precipitation
Comment:		The product will contribute to satisfying this Standard, with reference to clauses 3.10.1 ⁽¹⁾⁽²⁾ and 3.10.5 ⁽¹⁾⁽²⁾ of this Standard. See section 3 of this Certificate.
Standard:	3.15	Condensation
Comment:		The product can contribute to satisfying this Standard, with reference to clauses 3.15.1 ⁽¹⁾⁽²⁾ and 3.15.5 ⁽¹⁾⁽²⁾ . See section 3 of this Certificate.
Standard:	7.1(a)	Statement of sustainability
Comment:		The product can contribute to satisfying the relevant requirements of Regulation 9, Standards 1 to 6, and therefore will contribute to a construction meeting a bronze level of sustainability as defined in this Standard.

Regulation:	12	Building standards – conversion
Comment:	Comments in relation to the product under Regulation 9, Standards 1 to 6, also apply to this Regulation, with reference to clause 0.12.1 ⁽¹⁾⁽²⁾ and Schedule 6 ⁽¹⁾⁽²⁾ .	
	(1) Technical Handbook (Domestic).	
	(2) Technical Handbook (Non-Domestic).	



The Building Regulations (Northern Ireland) 2012 (as amended)

Regulation:	23(1)(a)(i)	Fitness of materials and workmanship
Comment:	(iii)(b)(i)	The product is acceptable. See sections 8 and 9 of this Certificate.
Regulation:	28(b)	Resistance to moisture and weather
Comment:		The product will contribute to satisfying this Regulation. See section 3 of this Certificate.
Regulation:	29	Condensation
Comment:		The product can contribute to satisfying this Regulation. See section 3 of this Certificate.
Regulation:	35(4)	Internal fire spread – structure
Comment:		The product can contribute to satisfying this Regulation. See section 2 of this Certificate.
Regulation:	36(a)	External fire spread
Comment:		The product is restricted by this Regulation. See section 2 of this Certificate.

Additional Information

NHBC Standards 2024

In the opinion of the BBA, Tyvek Housewrap, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements in relation to *NHBC Standards*, Chapters 6.1 *External masonry walls*, 6.2 *External timber framed walls*, 6.9 *Curtain walling and cladding* and 6.10 *Light steel framed walls and floors*.

Fulfilment of Requirements

The BBA has judged Tyvek Housewrap to be satisfactory for use as described in this Certificate. The product has been assessed as a breather membrane in walls of timber-frame (either factory or site applied), steel-frame and masonry constructions behind lightweight cladding panels and masonry facades.

ASSESSMENT

Product description and intended use

The Certificate holder provided the following description for the product under assessment. Tyvek Housewrap is a non-woven, HDPE breather membrane.

The product has the nominal characteristics given in Table 1.

Table 1 Nominal characteristics of Tyvek Housewrap

Characteristic (unit)	Value
Thickness (mm)	0.185
Mass per unit area (g·m ⁻²)	63
Roll length (m)	50 and 100
Roll width (m)	1.4, 1.5, 2.8 or 3.0
Colour	White or grey

Ancillary Items

The following ancillary items are essential to use with the product and have been assessed with the product:

- Air and vapour control layers (AVCLs) or air leakage barriers (see Product Sheets 4, 5 and 10 of this Certificate)
- Tyvek Acrylic Tape (2060B) – a single-sided tape for sealing joints
- Tyvek Double-sided Tape (1310D) – an acrylic tape for sealing joints.
- Tyvek Butyl Tape (1311B) – a double-sided tape for sealing penetrations, eg behind metal brackets and timber battens under compression.

Definitions for products and applications inspected

In the absence of other guidance, suitable external masonry wall, external timber-framed wall, curtain walling and light cladding, and light steel frame wall constructions are defined as those designed and built in accordance with *NHBC Standards 2024*, Chapters 6.1, 6.2, 6.9 and 6.10 respectively.

Product assessment – key factors

The product was assessed for the following key factors, and the outcome of the assessments is shown below. Conclusions relating to the Building Regulations apply to the whole of the UK unless otherwise stated.

1 Mechanical resistance and stability

Data were assessed for the following characteristics.

1.1 Resistance to mechanical damage

1.1.1 Results of resistance to mechanical damage tests are given in Table 2.

Table 2 Mechanical damage tests

Product assessed	Assessment method	Requirement	Result
Tyvek Housewrap	Nail tear	≥ 50 N	
	to BS EN 12310-1 : 2000		
	Longitudinal direction		Pass
	Transverse direction		Pass
	Tensile strength	Declared values	
	to BS EN 12311-1 : 2000		
	Longitudinal direction	≥ 280 N·(50 mm) ⁻¹	Pass
	Transverse direction	≥ 270 N·(50 mm) ⁻¹	Pass
	Elongation	Declared values	
	to BS EN 12311-1 : 2000		
	Longitudinal direction	≥ 15%	Pass
	Transverse direction	≥ 16%	Pass
	Tensile wet strength to	change < 20%	
	BS EN 12311-1 : 2000 – water soaked		Pass
	at 20°C for 24 hours (tested wet) and		
	56 days (tested dry)		Pass

1.1.2 On the basis of data assessed, the product has adequate strength to resist the loads associated with construction and installation into a building.

1.1.3 The product is not adversely affected by water and will retain its properties when wet.

2 Safety in case of fire

Data were assessed for the following characteristics.

2.1 Reaction to fire

2.1.1 The results of a reaction to fire test are given in Table 3.

Table 3 Reaction to fire test

Product assessed	Assessment method	Requirement	Result
Tyvek Housewrap	Reaction to fire classification in accordance with EN 13501-1 : 2018 ⁽¹⁾ tested in accordance with EN ISO 11925-2 : 2020	Value achieved	Class E ⁽²⁾

(1) Classification report MA 39 – 23 – 09667 and test report MA 39 – 23 -09643, issued by Magistratsabteilung 39 – Prüf -, Inspektions-und Zertifizierungsstelle der Stadt Wien. A copy of the report is available from the Certificate holder on request.

(2) Tested on mineral wool and wood.

2.1.2 On the basis of data assessed, the product will be restricted in use under the documents supporting the national Building Regulations in some cases.

2.1.3 In England, Wales and Northern Ireland, the product must not be used on buildings that have a storey at least 18 m above ground level and which contain one or more dwellings, an institution, a room for residential purposes (excluding, in Wales and Northern Ireland only, any room in a hostel, hotel or boarding house), student accommodation, care homes, sheltered housing, hospitals or dormitories in boarding schools and, additionally in Northern Ireland, nursing homes and places of lawful detention.

2.1.4 In Scotland, the use of the product is unrestricted in terms of height and proximity to a relevant boundary by the documents supporting the national Building Regulations. However, restrictions on the overall construction may apply, depending on the reaction to fire classification achieved by the built-up system, which must be established on a case by case basis.

2.1.5 Designers must refer to the relevant national Building Regulations and guidance for detailed conditions of use, particularly in respect of requirements for substrate fire performance, cavity barriers, service penetrations and combustibility limitations for other materials and components used in the overall construction.

3 Hygiene, health and the environment

Data were assessed for the following characteristics.

3.1 Weathertightness

3.1.1 Results of weathertightness tests are given in Table 4.

Table 4 Weathertightness tests

Product assessed	Assessment method	Requirement	Result
Tyvek Housewrap	Watertightness to BS EN 1928 : 2000 (A) and BS EN 13859-2 : 2014	Class W1	Pass
	Hydrostatic head to BS EN 20811 : 1992	Declared value 1.5 m	Pass

3.1.2 On the basis of data assessed, the product is Class W1 in accordance with BS EN 13859-2 : 2014 and will resist liquid water penetration and wind-blown snow and will protect the sheathing and frame from external moisture.

3.1.3 The product satisfies the NHBC requirement given in *NHBC Standards 2024*, Chapter 6.2, for use in very severe conditions⁽¹⁾.

(1) Very severe conditions are defined in the *NHBC Standards 2024*, Chapter 6.1.6 (see Exposure Zones map, showing categories of exposure to wind-driven rain).

3.1.4 The product resists penetration of liquid water and consequently can be used as temporary weather protection during construction, prior to the completion of external brickwork or cladding. The period of such use must, however, be kept to a minimum, and must not exceed four months. The membrane must be adequately secured during this time and suitable precautions taken during periods of high wind. Advice must be sought from the Certificate holder, but such advice is outside the scope of this Certificate.

3.2 Condensation

3.2.1 Results of water vapour resistance tests are given in Table 5.

Table 5 Water vapour resistance tests			
Product assessed	Assessment method	Requirement	Result
Tyvek Housewrap	Water vapour transmission rate to BS EN ISO 12572 : 2016 Climate C	Value achieved	1590 g·m ⁻² day ⁻¹
	Water vapour diffusion - equivalent air layer thickness (s_d) to BS EN ISO 12572 : 2016 Climate C	$\leq 0.12 \text{ m}^{(1)}$	Pass
	Water vapour resistance to BS EN ISO 12572 : 2016 Climate C	$\leq 0.6 \text{ MN}\cdot\text{s}\cdot\text{g}^{-1}$	Pass

(1) Water vapour resistance may be taken as $5 \times s_d$ value

3.2.2 A condensation risk analysis was carried out based on the result given in Table 5, and satisfactory conclusions were drawn.

3.2.3 The product's water vapour resistance is less than or equal to $0.25 \text{ MN}\cdot\text{s}\cdot\text{g}^{-1}$, and it is classified as a low resistance (LR) membrane in accordance with BS 5250 : 2021. It will, therefore, contribute towards minimising the risk of interstitial condensation in walls designed and constructed in accordance with BS 5250 : 2021.

4 Safety and accessibility in use

Not applicable.

5 Protection against noise

Not applicable.

6 Energy economy and heat retention

Not applicable.

7 Sustainable use of natural resources

The product is made from polyethylene, which can be recycled.

8 Durability

8.1 The potential mechanisms for degradation and the known performance characteristics of the materials in this product were assessed.

8.2 Specific test data were assessed as shown in Table 6.

Table 6 Durability tests

Product assessed	Assessment method	Requirement	Result
Tyvek Housewrap	Dimensional stability to BS EN 1107-2 : 2001	$\leq \pm 2\%$	Pass
	Flexibility at low temperature to BS EN 1109 : 2013	Declared value $\leq -40^{\circ}\text{C}$	Pass
	Tensile strength to BS EN 12311-1 : 2000 ageing to BS EN 13859-1 : 2005 Annex C	Declared values	
	Longitudinal direction	$\geq 224 \text{ N}\cdot(50 \text{ mm})^{-1}$	Pass
	Transverse direction	$\geq 216 \text{ N}\cdot(50 \text{ mm})^{-1}$	Pass
	Elongation to BS EN 12311-1 : 2000 ageing to BS EN 13859-1 : 2005 Annex C	Declared values	
	Longitudinal direction	$\geq 10.5\%$	Pass
	Transverse direction	$\geq 11\%$	Pass

8.3 Service life

Under normal service conditions, the product will have a life equivalent to the structure in which it is incorporated, provided it is designed, installed and maintained in accordance with this Certificate and the Certificate holder's instructions.

PROCESS ASSESSMENT

Information provided by the Certificate holder was assessed for the following factors:

9 Design, installation, workmanship and maintenance

9.1 Installation

9.1.1 Installation instructions provided by the Certificate holder were assessed and judged to be appropriate and adequate.

9.1.2 The product must be installed in accordance with the Certificate holder's instructions, the provisions of this Certificate and the recommendations given in *NHBC Standards 2024*, Chapters 6.1, 6.2, 6.9 and 6.10, where appropriate. A summary of instructions and guidance is provided in Annex A of this Certificate.


9.1.3 Where wood preservatives and damp-proofing treatments containing solvents have been applied, sufficient time must be allowed for solvents to disperse before the product is installed.

9.1.4 The product can be damaged by high winds, careless handling or vandalism and must not be left exposed for longer than is necessary.

9.1.5 The product must be fixed in such a way as to shed water away from the sheathing, and below the lowest timber. Upper layers must be lapped over lower layers.

9.1.6 Horizontal laps must be at least 100 mm and vertical laps 150 mm. Vertical laps must be staggered wherever possible (see Figure 1).

Figure 1 Laps (dimensions in mm)

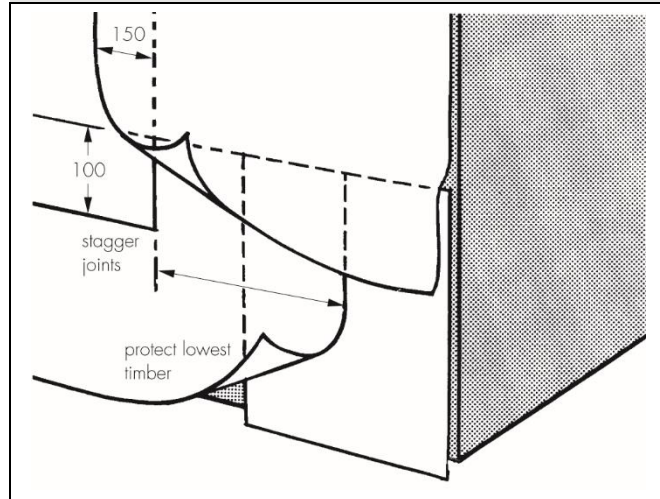

9.1.7 To assist in achieving the design air permeability, the lap joints and penetrations through the product can be sealed with Tyvek Acrylic Tape (2060B) or Tyvek Double-sided Tape (1310D).

9.1.8 When used in timber frame constructions, the product must be mechanically fastened to the substrate using vertical battens to protect all fixing penetrations and prevent damage by wind (see Figures 2 to 4). Where vertical battens are not suitable, the membrane must be secured using either individual point fixings such as external grade nails or staples, or screw fixed wall ties. Tyvek Butyl Tape (1311B) and Tyvek Double-sided Tape (2060B) can be used to minimise the impact of the fixings on the integrity of the membrane. The fixing intervals are horizontally at 600 mm centres or at stud positions and vertically at 300 mm centres. In addition, fixings are required at 150 mm centres at openings, vertical membrane joints and at the end of panels.

Figure 2 Factory method of installation on timber-frame panel

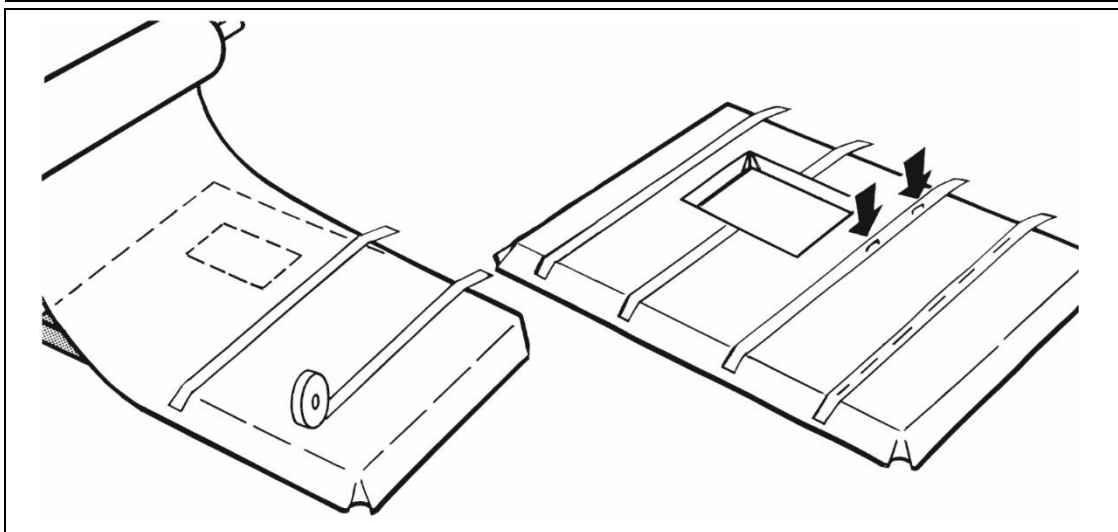


Figure 3 Site installation — external corner


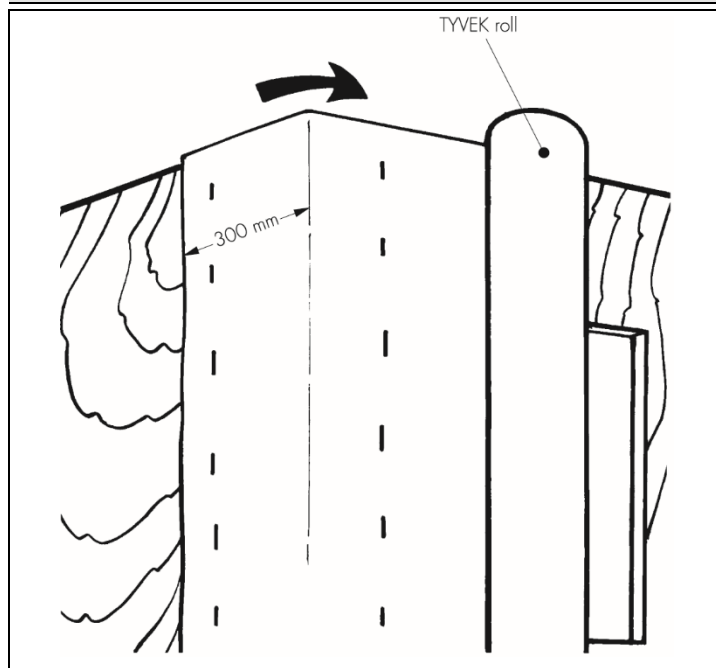


Figure 4 Site installation — opening (internal view of window)

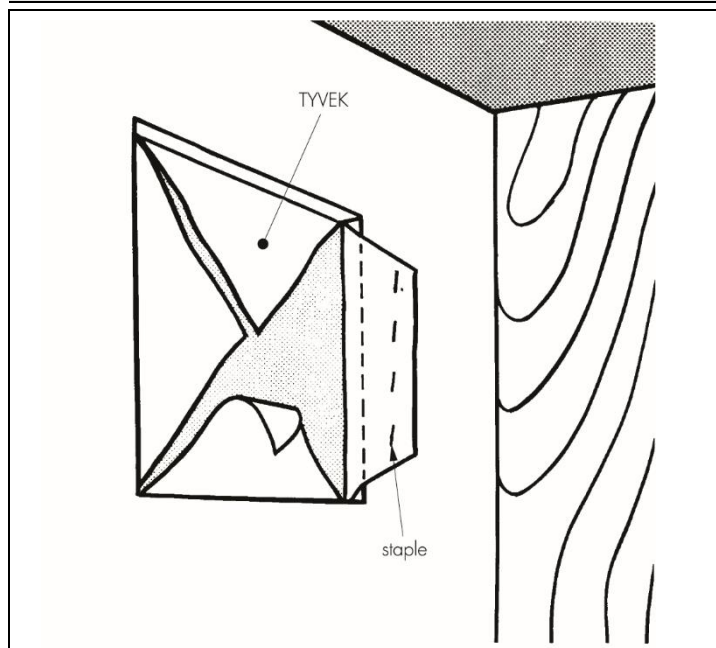

9.1.9 Nails must be of galvanized or sherardized mild steel, austenitic stainless steel, phosphor bronze or silicon bronze. Staples must be of austenitic stainless steel.

9.1.10 It is essential that the positions of studs are marked to enable wall tie fixing.

9.1.11 It is essential that the lowest timbers in the wall are protected by the breather membrane.

9.1.12 When used in steel frame constructions, the product must be mechanically secured to the steelwork or an external grade sheathing board. When fixing to steelwork (SFS), the product can be secured using Tyvek Double-sided (1310D) Tape and a 25 mm steel framing screw with an EPDM rubber washer, in accordance with the Certificate holder's instructions. When used over a mineral sheathing board, the product must be fastened using an appropriate fixing system, such as Stainless-Steel Staples, screw fixings, cladding brackets or wall ties, according to the sheathing type and in accordance with the Certificate holder's instructions. Tyvek Butyl Tape (1311B) or Tyvek Double-sided Tape (1310D) can be used for temporary adhesion to the substrate prior to securing with mechanical fasteners.

9.1.13 When used in masonry constructions, the product is fastened to the masonry using an appropriate anchor fixing system or a masonry nail/screw and an EPDM rubber washer. Fixing should be at maximum 500 mm centres. Tyvek Double-sided Tape (1310D) can be used to fix the membrane in addition to the mechanical method. For airtightness, Tyvek Butyl Tape (1311B) must be used at fixing points where a compressible washer is not employed. A primer can be applied to chalky or porous masonry to seal the surface and improve adhesion before applying adhesive tape.

9.2 Workmanship

Practicability of installation was assessed by the BBA, on the basis of the Certificate holder's information and a visit to site to assess the practicability of installation. To achieve the performance described in this Certificate, the product must be installed by a competent general builder, or a contractor, experienced with this type of product.

9.3 Maintenance and repair

9.3.1 As the product is confined within a wall construction and has suitable durability, maintenance is not required.

9.3.2 Damage to the product must be repaired prior to the installation of the external walls or cladding, by laying another sheet over the damaged area and sealing correctly using Tyvek Acrylic Tape (2060B), ensuring water is shed away from the sheathing. Small linear tears can be fixed using a strip of Tyvek Acrylic Tape (2060B).

10 **Manufacture**

10.1 The production processes for the product have been assessed, and provide assurance that the quality controls are satisfactory according to the following factors:

10.1.1 The manufacturer has provided documented information on the materials, processes, testing and control factors.

10.1.2 The quality control operated over batches of incoming materials has been assessed and deemed appropriate and adequate.

10.1.3 The quality control procedures and product testing to be undertaken have been assessed and deemed appropriate and adequate.

10.1.4 The process for management of non-conformities has been assessed and deemed appropriate and adequate.

10.1.5 An audit of each production location was undertaken, and it was confirmed that the production process was in accordance with the documented process, and that equipment has been properly tested and calibrated.

† 10.2 The BBA has undertaken to review the above measures on a regular basis through a surveillance process, to verify that the specifications and quality control operated by the manufacturer are being maintained.

11 **Delivery and site handling**

11.1 The Certificate holder stated that the product is delivered to site in rolls with paper wrapping bearing the Certificate holder's name, the grade identification, the technical specifications, installation instructions and the BBA logo incorporating the number of this Certificate.

11.2 Delivery and site handling must be performed in accordance with the Certificate holder's instructions and this Certificate, including:

11.2.1 Rolls must be stored flat on their sides, on a smooth, clean, dry surface, under cover and protected from sunlight.

ANNEX A – SUPPLEMENTARY INFORMATION †

Supporting information in this Annex is relevant to the product but has not formed part of the material assessed for the Certificate.

Construction (Design and Management) Regulations 2015

Construction (Design and Management) Regulations (Northern Ireland) 2016

Information in this Certificate may assist the client, designer (including Principal Designer) and contractor (including Principal Contractor) to address their obligations under these Regulations.

CE marking

The Certificate holder has taken the responsibility of CE marking the product in accordance with harmonised European Standard EN 13859-2 : 2010.

Management Systems Certification for production

The management systems of the manufacturer. have been assessed and registered as meeting the requirements of EN ISO 9001 : 2015 by DQS GmbH (Certificate 000093 QM15) and EN ISO 14001 : 2015 by Lloyd's Register (Certificate 10322753).

Additional information on installation

Condensation

A.1 The risk of condensation occurring within the wall of a timber-frame building will depend upon the properties and vapour resistance of other materials used in the construction, the internal and external conditions and the effectiveness of the internal vapour control layer.

A.2 Convective water transfer into the wall construction can be reduced by installing a vapour control layer/air barrier, such as the DuPont AirGuard AVCLs or air leakage barrier, behind the internal lining (see Product Sheets 4, 5 and 10 of this Certificate).

Bibliography

BS 5250 : 2021 *Management of moisture in buildings – Code of practice*

BS EN 1107-2 : 2001 *Flexible Sheets For Waterproofing – Determination Of Dimensional Stability – Plastic And Rubber Sheets For Roof Waterproofing*

BS EN 1109 : 2013 *Flexible sheets for waterproofing – Bitumen sheets for roof waterproofing – Determination of flexibility at low temperature*

BS EN 1928 : 2000 *Flexible sheets for waterproofing – Bitumen, plastic and rubber sheets for roof waterproofing – Determination of watertightness*

BS EN 12310-1 : 2000 *Flexible sheets for waterproofing – Determination of resistance to tearing (nail shank) – Bitumen sheets for roof waterproofing*

BS EN 12311-1 : 2000 *Flexible sheets for waterproofing – Determination of tensile properties Bitumen sheets for roof waterproofing*

BS EN 13859-1 : 2005 *Flexible sheets for waterproofing – Definitions and characteristics of underlays – Underlays of discontinuous roofing*

BS EN 13859-2 : 2014 *Flexible sheets for waterproofing – Definitions and characteristics of underlays Part 2: Underlays for walls*

BS EN 20811 : 1992 *Textiles – Determination Of Resistance To Water Penetration – Hydrostatic Pressure Test*

EN 13501-1 : 2018 *Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests*

EN 13859-2 : 2010 *Flexible sheets for waterproofing – Definitions and characteristics of underlays Part 2: Underlays for walls*

EN ISO 9001 : 2015 *Quality management systems – Requirements*

EN ISO 11925-2 : 2020 *Reaction to fire tests – Ignitability of products subjected to direct impingement of flame – Part 2: Single-flame source test*

EN ISO 14001 : 2015 *Environmental management systems – Requirements with guidance for use*

Conditions of Certificate

Conditions

1 This Certificate:

- relates only to the product that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page – no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- is valid only within the UK
- has to be read, considered and used as a whole document – it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English Law.

2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

3 This Certificate will be displayed on the BBA website, and the Certificate Holder is entitled to use the Certificate and Certificate logo, provided that the product and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

5 In issuing this Certificate the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product or any other product
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product
- actual installations of the product, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to UKCA marking and CE marking.

6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product which is contained or referred to in this Certificate is the minimum required to be met when the product is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.

British Board of Agrément

1st Floor, Building 3, Hatters Lane
Croxley Park, Watford
Herts WD18 8YG

©2024

tel: 01923 665300
clientservices@bbacerts.co.uk
www.bbacerts.co.uk